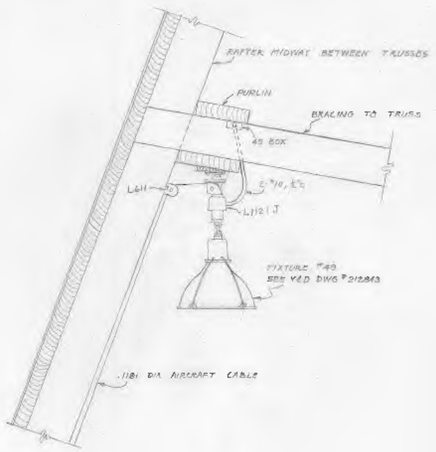

DETAIL 'B'
NO SCALE

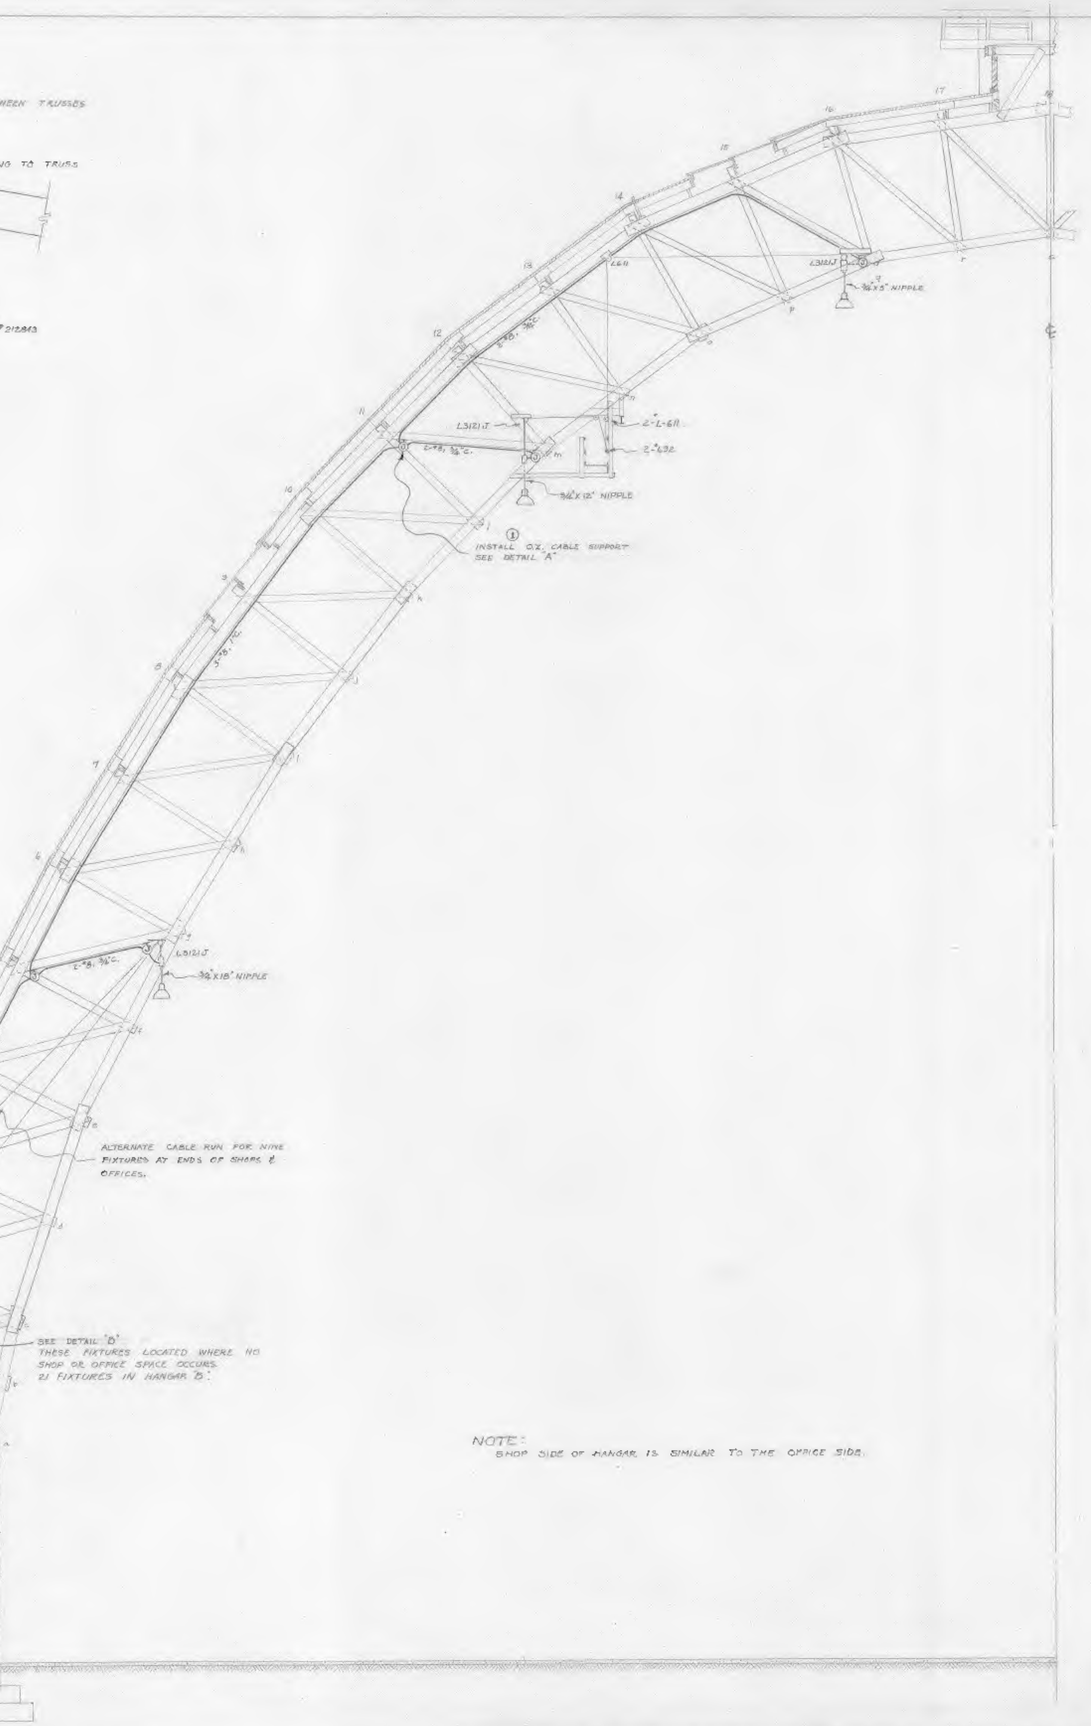

NOTE:
SHOP SIDE OF HANGAR IS SIMILAR TO THE OFFICE SIDE.

NOTE: ①
O.Z. CABLE SUPPORTS TO BE INSTALLED IN ALL VERTICAL CONDUIT RUNS ON TRUSSES, IN A SIMILAR MANNER AS THAT SHOWN ON THIS DWG., EXCEPT THAT RUNS OF #4/0 WIRE TO BE SUPPORTED EVERY 80 FT. OF VERTICAL RUN.

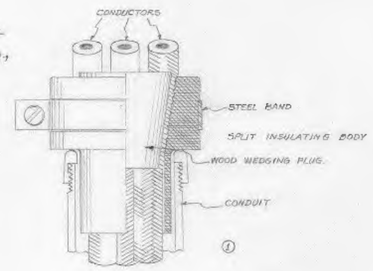

DETAIL 'A' - O.Z. CABLE SUPPORT
NO SCALE

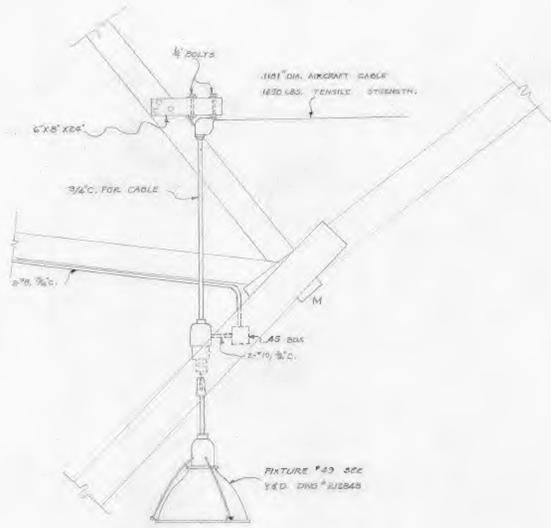

TYPICAL MOUNTING DETAIL
NO SCALE

300,331

REVISION	BY	DATE	BRIEF	APP'D.
2	ELH	5-26-43	ADDED LOWER FIXTURE & DETAIL 'D'	JRR
1	ELH	5-14-43	ADDED CABLE SUPPORT	JRR

CONST. CONTRACT NOy 5424

NEWBERY-CHANDLER-TILLAMOOK
TILLAMOOK, OREGON.

DRAWN ELH
TRACED ELH
CHECKED
APP'D.
DATE

U. S. NAVAL AIR STATION (L.T.A.)
TILLAMOOK, OREGON
HANGAR 'B' - ELECTRICAL DETAILS
MOUNTING METHOD FOR THOMPSON FIXTURES
SCALE ⅛" = 1'-0"
DATE APP'D. Apr 16, 1943.
APPROVED

DWG. NO. 9

SHEET OF

OFFICER IN CHARGE

1335-45-16